


3 Faz / 3 Faz UPS Bağlantı Şeması

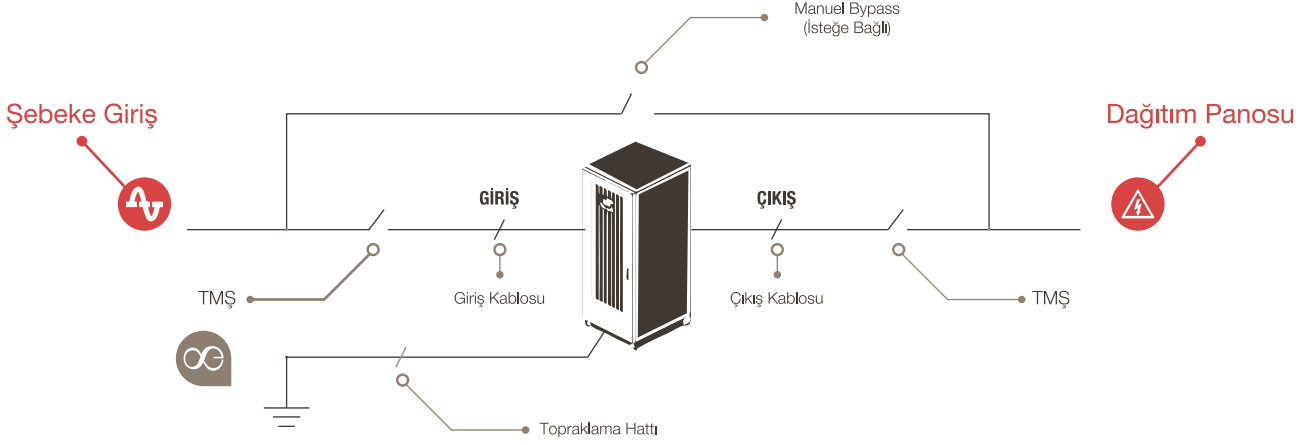

UPS Gücü (KVA)	Giriş Kablosu Kesiti	Çıkış Kablosu Kesiti	Topraklama Kablosu Kesiti	Giriş / Çıkış Sigortaları (TMS)
10	4x4 mm ²	4x4 mm ²	1x4 mm ²	40A
15	4x6 mm ²	4x6 mm ²	1x6 mm ²	40A
20	4x10 mm ²	4x10 mm ²	1x10 mm ²	63A
30	3x10+6 mm ²	3x10+6 mm ²	1x10 mm ²	80A
40	3x16+10 mm ²	3x16+10 mm ²	1x10 mm ²	100A
60	3x25+16 mm ²	3x25+16 mm ²	1x16 mm ²	160A
80	3x35+16 mm ²	3x35+16 mm ²	1x16 mm ²	200A
100	3x50+25 mm ²	3x50+25 mm ²	1x25 mm ²	250A
120	3x50+25 mm ²	3x50+25 mm ²	1x25 mm ²	300A
160	3x70+35 mm ²	3x70+35 mm ²	1x35 mm ²	300A
200	3x95+50 mm ²	3x95+50 mm ²	1x50 mm ²	400A
250	3x150+70 mm ²	3x150+70 mm ²	1x50 mm ²	500A
300	3x185+95 mm ²	3x185+95 mm ²	1x70 mm ²	630A
400	2/3x150+150 mm ²	2/3x150+150 mm ²	1x70 mm ²	800A
500	3/3x150+240 mm ²	3/3x150+240 mm ²	1x95 mm ²	1000A

* Not: UPS girişine bağımsız topraklama hattı çekilmelidir.

Birlik OSB 1 Nolu Cd. No:27
Tuzla, İstanbul
T: 216 494 0 444
F: 216 494 3 000
info@necron.com.tr

necron
energy