


1 Phase / 1 Phase UPS Wiring Diagram

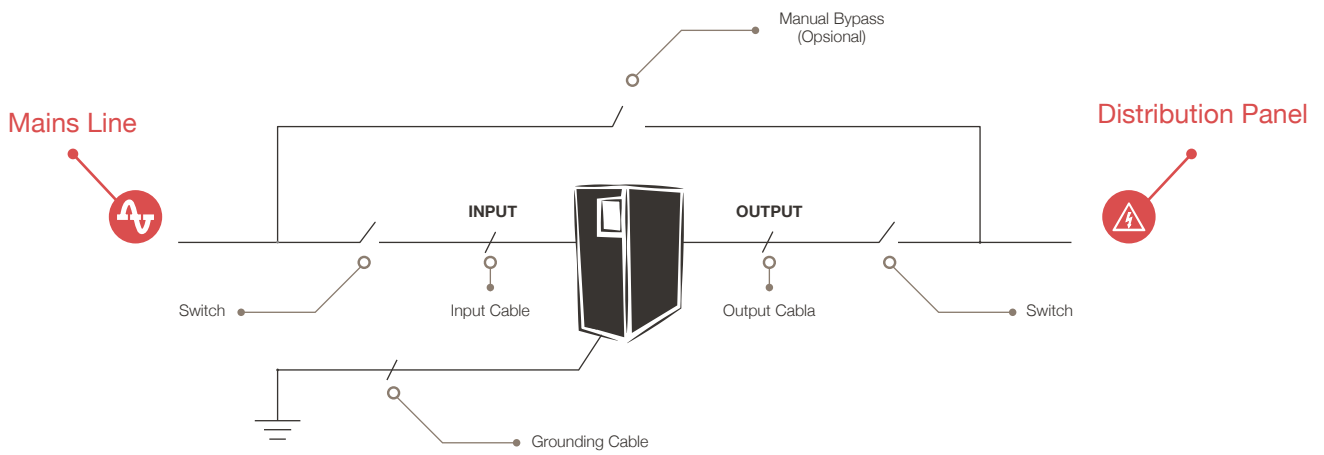

UPS Power (kVA)	Input Cable Section	Output Cable Section	Grounding Cable Section	Input / Output Switches (Circuit Breaker)
5	2x4 mm ²	2x4 mm ²	1x4 mm ²	1x40 A
6	2x4 mm ²	2x4 mm ²	1x4 mm ²	1x50 A
7.5	2x6 mm ²	2x6 mm ²	1x6 mm ²	1x63 A
10	2x6 mm ²	2x6 mm ²	1x6 mm ²	1x63 A
15	2x10 mm ²	2x10 mm ²	1x6 mm ²	1x80 A

* **Note:** Separated grounding line should be provided for UPS

Birlik OSB 1 Nolu Cd. No:27
 Tuzla, Istanbul, Turkey
 T: +90 216 494 0 444
 F: +90 216 494 3 000
 info@necron.com.tr